


MAN ENTRY CHAMBER

MAX DEPTH FROM GROUND LEVEL TO SOFFIT OF PIPE 3m

DIAMETER OF LARGEST PIPE IN MANHOLE (mm)	INTERNAL DIAMETER OF MANHOLE (mm)*
LESS THAN 375	1200
375 - 450	1350
500 - 700	1500
750 - 900	1800
GREATER THAN 900	PIPE DIAMETER +900


* THE SPECIFIED DIAMETERS ARE THE MINIMUM REQUIRED. WHERE MORE THAN ONE PIPE ENTERS A MANHOLE THE DIAMETER MUST BE INCREASED BY AT LEAST ONE SIZE INCREMENT TO SUIT CIRCUMSTANCES.

* NOTE 1050mm DIAMETER PRECAST RINGS ARE NOT ACCEPTABLE

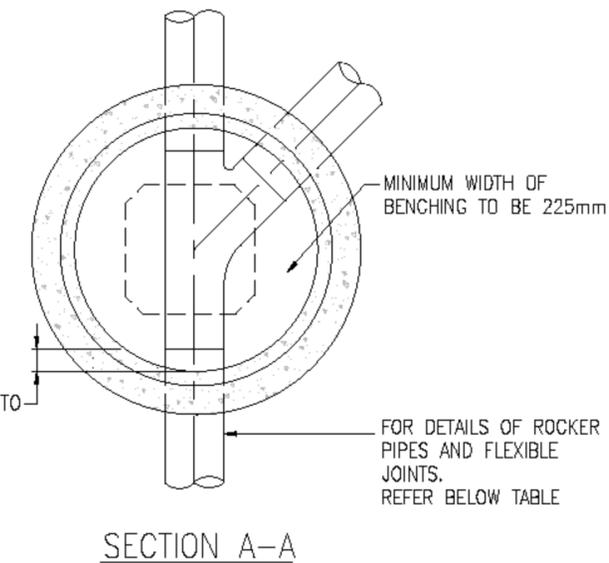

ROCKER PIPE DETAILS:

NOMINAL PIPE DIAMETER (mm)	MAXIMUM EFFECTIVE LENGTH (m)
150-600	0.6
601-750	1.0
OVER 750	1.25

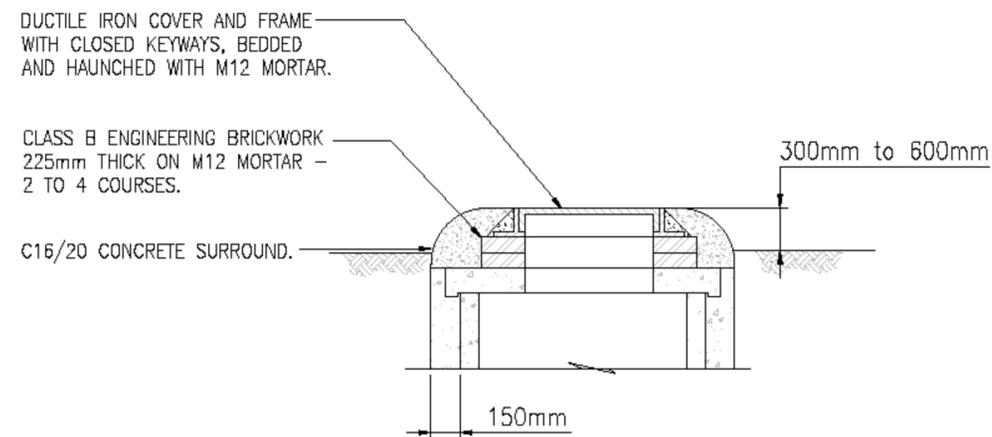

DETAIL OF MAN ENTRY CHAMBER TOP IN AGRICULTURAL LAND

NOTES

1. ALL DIMENSIONS ARE MILLIMETERS UNLESS OTHERWISE SPECIFIED.
2. DO NOT SCALE FROM THIS DRAWING. ONLY WRITTEN DIMENSIONS ARE TO BE USED.
3. REFER TO SPECIFICATION FOR GENERAL CONSTRUCTION.
4. ALL CONCRETE TO GIVE CLASS 4 SULPHATE RESISTANCE. GEN 3
5. REFER TO SEWERS FOR ADOPTION

NOTES FOR DESIGNER

REV.	DATE	DESCRIPTION	BY

COMPANY DETAILS:

CONTRACTORS DRAWING NO.	REVISION

PROJECT TITLE

DRAWING TITLE
 PRECAST CONCRETE
 MAN ENTRY CHAMBERS
 MAX DEPTH TO SOFFIT OF
 PIPE UP TO 3.0m

SCALE	DRAWN	DATE	SIZE
N.T.S			
DESIGNED	CHECKED	APPROVED	DATE
DISCIPLINE	STATUS	SITE	

DRAWING NO.	REVISION
1.....	