



Problem Characterisation

Scaynes Hill (SCAY)

This document describes the causes of the risks identified by the Baseline Risk and Vulnerability Assessment (BRAVA). The BRAVA results for this wastewater system are summarised in Table 1. The results indicate that flooding, pollution and water quality are the main concerns in this wastewater system. We have completed risk assessments for 2050 where we have the data and tools available to do so. For the other planning objectives, we will explore how we can predict future risks for the next cycle of DWMPs. All the risk assessment methods need to be reviewed after the first DWMPs have been produced with a view to improve the methods and data for future planning cycles.

Table 1: Results of the BRAVA for Scaynes Hill wastewater system

Planning Objectives		2020	Driver	2050
1	Internal Sewer Flooding Risk	1	Customer	
2	Pollution Risk	1	Customer	
3	Sewer Collapse Risk	2	Operational	
4	Sewer Flooding in a 1 in 50-year storm	1	Hydraulic	1
5	Storm Overflow Performance	1	Hydraulic	1
6	WTW Water Quality Compliance	1	Quality	1
7	Flooding due to Hydraulic Overload	1	Hydraulic	1
8	WTW Dry Weather Flow Compliance	0	-	0
9	Good Ecological Status / Good Ecological Potential	0	-	
10	Surface Water Management	1	Hydraulic	
11	Nutrient Neutrality	NA	-	NA
12	Groundwater Pollution	0	-	
13	Bathing Waters	NA	-	
14	Shellfish Waters	NA	-	

Key

BRAVA Risk Band	
NA	Not Applicable*
0	Not Significant
1	Moderately Significant
2	Very Significant

*No issues relevant to planning objective within Wastewater System

Investment Strategy

The risks identified in this wastewater system mean that we have assigned the following investment strategy:

Improve

This means that we consider that the current performance of the drainage and wastewater system needs to be improved to reduce the impacts on our customers and/or the environment. We will plan investment to reduce the current risks by actively looking to invest capital funding in the short term to address current performance issues (and consider future risks when implementing improvements).




Planning Objective 1: Internal Sewer Flooding Risk

The number of internal sewer flooding incidents reported during the three years considered by the risk assessment are shown in Figure 1. The total number of connections in this wastewater system means there have been between 1.68 and 3.35 incidents per 10,000 connections per year (a threshold set by Ofwat) so the risk is in the 'moderately significant' band.2

The primary driver for internal sewer flooding in this wastewater system is 'Customer'. Blockages caused 57% of all incidents recorded in this wastewater system. Blockages are often caused by fats, oils, greases, nappies, wet wipes and sanitary products within the system. These items are non-flushable and should not be disposed of into wastewater systems.

Figure 1: Number of internal flooding incidents per annum and causes

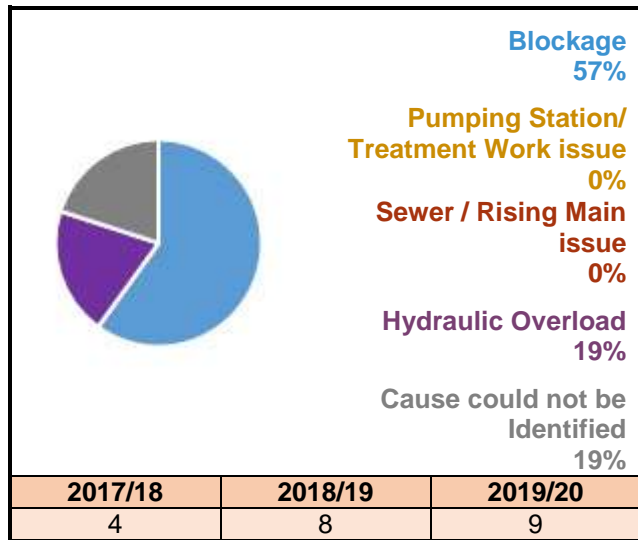


Planning Objective 2: Pollution Risk

The number of pollution incidents reported during the three years considered by the risk assessment are shown in Figure 2. The length of sewer in this wastewater system means there have been between 24.51 and 49.01 incidents per 10,000km per year (a threshold set by Ofwat) so the risk is in the 'moderately significant' band.

The primary driver for pollution is 'Customer'. Blockages caused 100% of all incidents recorded in this wastewater system. Blockages are often caused by fats, oils, greases, nappies, wet wipes and sanitary products within the system. These items are non-flushable and should not be disposed of into wastewater systems.

Figure 2: Number of pollution incidents per annum and causes

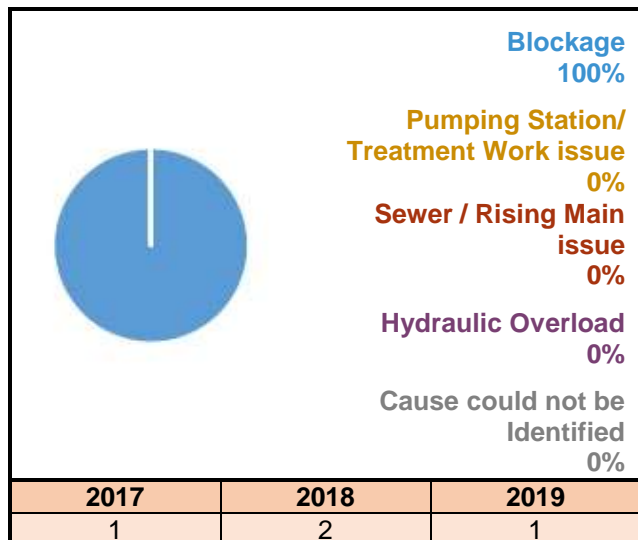

Planning Objective 3: Sewer Collapse Risk

The number of sewer collapses reported during the three years considered by the risk assessment are shown in Table 2. The length of sewer in this wastewater system means there have been more than 9.44 incidents per 1,000km per year (a threshold set by Ofwat) so the risk is in the 'very significant' band.

The primary driver is 'Operational' as the cause of these collapses and bursts is due to the age and condition of the sewers.

Table 2: Sewer collapses and rising main bursts

Sewer Collapse	2017/18	1
	2018/19	3
	2019/20	3
Rising Main Bursts	2017/18	1
	2018/19	2
	2019/20	1

Planning Objective 4: Sewer Flooding in a 1 in 50 Year Storm

The risk of flooding in a 1 in 50 year storm is moderately significant in 2020 and 2050. This is because our computer model of the sewer network indicate for 2020 that approximately 600 - 700 properties within this wastewater system are in areas that could flood by water escaping from sewers. This model prediction increases the number of properties in areas at risk from flooding to approximately 900 - 1000 by 2050.

Our wastewater networks are generally designed with capacity for up to a 1 in 30 year storm, hence flooding is expected to occur during more severe storms such as a 1 in 50 year event. Flooding will occur due to insufficient capacity of the drainage system either on the surface before it enters the drainage system, and/or from manholes, in people's homes or at a low point elsewhere in the system.

Planning Objective 5: Storm Overflow Performance

The storm overflow performance risk has been assessed as moderately significant in 2020 and 2050. Table 3 shows the overflows that discharge above the low threshold set for storm overflow discharges to Shellfish Water, Bathing Water and inland rivers.

The primary driver for the Storm Overflow Performance is 'Hydraulic.'

Table 3: Overflows exceeding discharge frequency threshold per annum

	Number of overflows		Threshold for number of discharges per annum		
	2020	2050	Low	Medium	High
Shellfish Waters	0 Medium	0 Medium	Less than 8	Between 8-10	10 or more
Bathing Waters	0 Medium	0 Medium	Less than 3	Between 3-10	10 or more
Freshwater	2 Medium	2 Medium	Less than 20	Between 20-40	40 or more

Planning Objective 6: Wastewater Treatment Works Water Quality Compliance

The risk of non-compliance with our wastewater quality permit has been assessed as moderately significant for both 2020 and 2050. This is because the compliance status of the wastewater treatment works in 2018 and 2020 was Sub Critical. Future forecast growth for 2050 was assessed to not have an adverse affect for the risk score.

Planning Objective 7: Flooding due to Hydraulic Overload

This is an assessment of the risk of flooding from sewers during a 1 in 30 year storm, and more frequent rainfall, to understand where flooding could occur. The risk of sewer flooding due to hydraulic overload is moderately significant in 2020 and 2050. The annualised number of properties in areas at risk of flooding is shown in Table 4.

Table 4: Annualised number of properties at risk per 10,000 connections.


Rainfall Return Period (yr)	Number of Properties at Risk		Annualised per 10,000 connections	
	2020	2050	2020	2050
1 in 1	49	95	31	60
1 in 2	74	107	29	42
1 in 5	154	253	28	46
1 in 10	252	459	24	44
1 in 20	415	654	20	32
1 in 30	501	799	16	26
Total Annualised			149	250

This indicates that the capacity of the wastewater network can be exceeded during 1 in 30 year storms (or more frequent events). Future growth, creep and/or climate change are not anticipated to significantly increase the risk by 2050.

Planning Objective 8: Wastewater Treatment Works Dry Weather Flow Compliance

The risk of Wastewater Treatment Works Dry Weather Flow (DWF) Compliance is not significant for both 2020 and 2050. This is because the average annual DWF for 2017, 2018 and 2019 has been below 80% of the current permit. The predicted DWF in 2050 is also expected to remain below 80% of the current permit, shown in Figure 3.

Figure 3: Recorded and predicted dry weather flow with existing permit

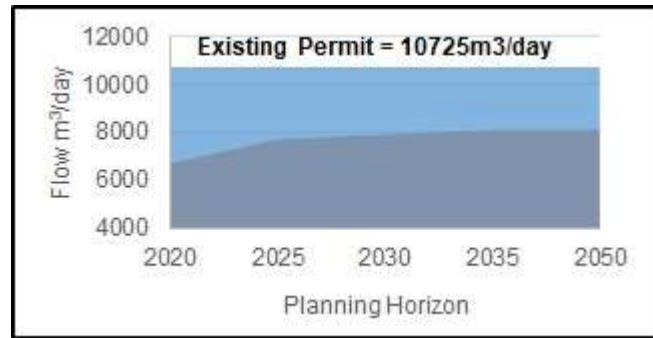

Planning Objective 9: Good Ecological Status / Good Ecological Potential

Table 5 shows the waterbodies connected to this wastewater system are not achieving Good Ecological Status or Potential (GES/GEP). The Environment Agency has attributed the 'reasons for not achieving good status' to water company operations. Our risk assessment has been assessed based on the worst assigned status (Poor) and has been moderated from moderately significant to not significant because of the presence of Tertiary Treatment at the wastewater system Treatment Works.

Table 5: Waterbodies not achieving GES/GEP


Waterbody	Classification	EA-Status	Activity
Ouse Ardingly to confluence with Scrase Brk	Macrophytes and Phytobenthos Combined	Moderate	Sewage discharge (continuous)
Ouse Ardingly to confluence with Scrase Brk	Phosphate	Moderate	Sewage discharge (continuous)
Adur (Burgess Hill)	Invertebrates	Poor	Sewage discharge (intermittent)
Adur (Burgess Hill)	Phosphate	Moderate	Sewage discharge (intermittent)
Adur (Burgess Hill)	Phosphate	Moderate	Sewage discharge (continuous)

Planning Objective 10: Surface Water Management

Our initial high level assessment indicated that there is moderately significant interaction between surface water flooding and flooding from sewers in this wastewater system. The cause of this localised flooding is the capacity of the drainage network in these areas to convey both wastewater and surface water run-off.

Figure 4 illustrates the sources of water flowing in the wastewater system during a 1 in 20 year storm. It shows that surface water runoff from roofs, road and permeable surfaces constitutes more than 68.6% of the flow in the sewers. The total contribution of foul water from homes is 5.7% with business contributing 0.1%. The baseflow is infiltration from water in the ground and makes up 25.6% of the flow in the system.

Figure 4: Sources of water flowing in sewers during a 1 in 20 year storm

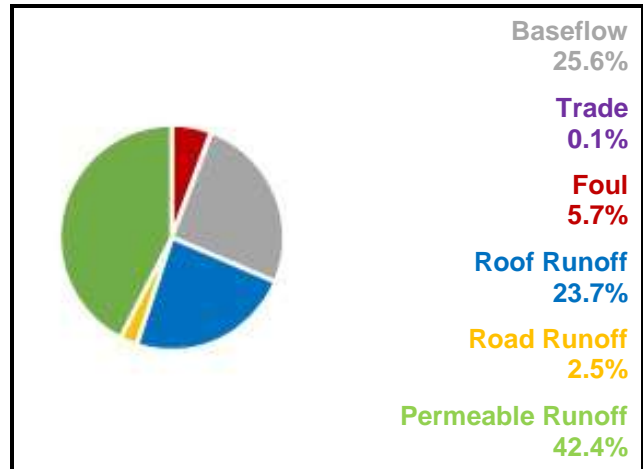

Planning Objective 11: Nutrient Neutrality

This wastewater system is not hydraulically linked to Habitat Sites noted as under threat by Natural England.

Planning Objective 12: Groundwater Pollution

The risk of Groundwater Pollution is not significant. This is because the wastewater network in this wastewater system does not overlap with any groundwater Source Protection Zones (SPZ) used for water supply.

Planning Objective 13: Bathing Waters

This wastewater system does not discharge into a designated bathing water.

Planning Objective 14: Shellfish Waters

The discharges from this wastewater system do not impact on any designated shellfish waters.

Southern Water

August 2021
Version 1